

OPWC DISTRICT 4 INTEGRATING COMMITTEE
FY25 APPLICATION SUMMARY

10

SUBDIVISION: Brookville CONTACT PERSON: Sonja Keaton
PROJECT NAME: Main Street Water Main Replacement, Phase II

CRITERIA		RESPONSE			
	Project Type	Water Supply			
	General Project Summary	Install 650' of 8" and 20' of 10" DPI water main, 625' of 1" Type K copper water service branches to user, replacement of a fire hydrant, minor storm repair and asphalt replacement on Main Street between Columbia and Salem Streets.			
1.	Priority Project?	No			
2.	Total Project Cost	\$373,195			
	Funding Requested SCIP	\$373,195			
	Funding Requested LTIP	n/a			
	New/ Expansion	\$0			
3.	Type of Request	100% Loan			
4.	Local Match SCIP	\$373,195	100%		
	Local Match LTIP	n/a			
5.	Economic Health	3			
6.	Infrastructure Age	67 years			
7.	Generation of Revenue	None			
8.	Additional Funding	None			
9.	Readiness of Project	Ready to Proceed			
10.	Health & Safety - Category	Water			
	Response	Existing water lines have the end of its useful life. Replacing water main to improve fire protection and to eliminate tuberculation.			
11.	Addresses District Needs	System Users	17	Avg. Daily Traffic	
		Acres Drained		Project in Multiple Communities?	
		Percent of Community Served?			Less than 25%
12.	Economic development	None			
	# jobs being created				
	# jobs retained				
13.	Relieves Traffic Congestion Responds to Growth	n/a			<i>LTIP only Criteria</i>
14.	Weighted Useful Life	34 years			
15.	Engineering as % of Construction	10%			
16.	Other Factors	See attached			
COMMENTS					

1.0 Project Financial Information (All Costs Rounded to Nearest Dollar)

1.1 Project Estimated Costs

Engineering Services

Preliminary / Final Design: _____ .00
Construction Administration: _____ .00
Total Engineering Services: a.) _____ .00 _____ %
Right of Way: b.) _____ .00
Construction: c.) _____ .00
Permits, Advertising, Legal: e.) _____ .00
Construction Contingencies: f.) _____ .00
Total Estimated Costs: g.) _____ .00

1.2 Project Financial Resources

Local Resources

Local In-Kind or Force Account: a.) _____ .00
Local Revenues: b.) _____ .00
Other Public Revenues:
Local / ODOT - Let: _____ d.) _____ .00
ODOT PID: _____
OEPA / OWDA: e.) _____ .00
CDBG: f.) _____ .00
Other: _____ g.) _____ .00
Subtotal Local Resources: i.) _____ .00 _____ %

OPWC Funds (Check all requested and enter Amount)

Grant: _____ % of OPWC Funds j.) _____ .00
Loan: _____ % of OPWC Funds k.) _____ .00 _____ yrs
Loan Assistance / Credit Enhancement: l.) _____ .00
Subtotal OPWC Funds: m.) _____ .00 _____ %
Total Financial Resources: n.) _____ .00 _____ %

OHIO PUBLIC WORKS COMMISSION

DISTRICT 4

FY25 Supplemental Questionnaire

Applicant: City of Brookville

Project Title: Main Street Water Main Replacement, Phase II

Application Summary:

Briefly describe the project:


This water main replacement project consists of abandoning the existing 4" unlined cast iron water main last replaced in the mid 1950's and installing 650' of 8" DIP and 20' of 10" DIP water main including valves, 1" water services, fire hydrant, storm repair, street repairs and restoration.

This is the second phase of the water main replacement along Main Street. Phase I was completed in April 2023, which ran from Wolf Creek Street to Columbia Street, using the City's ARPA funds.

Other Factors

What other factors exist that make this project more important than other like projects?

In 2015, our Fire Chief and Service Department Superintendent identified water line priorities. Main Street is a high priority as it pertains to fire protection and water line quality. Please see attached spreadsheet. In 2016, the City of Brookville contracted with Poggemeyer Design Group to conduct a Water Study. Included is a copy of Table 9 from that Study that shows Main Street has a Priority Ranking of 1 out of 5 for water line replacement.

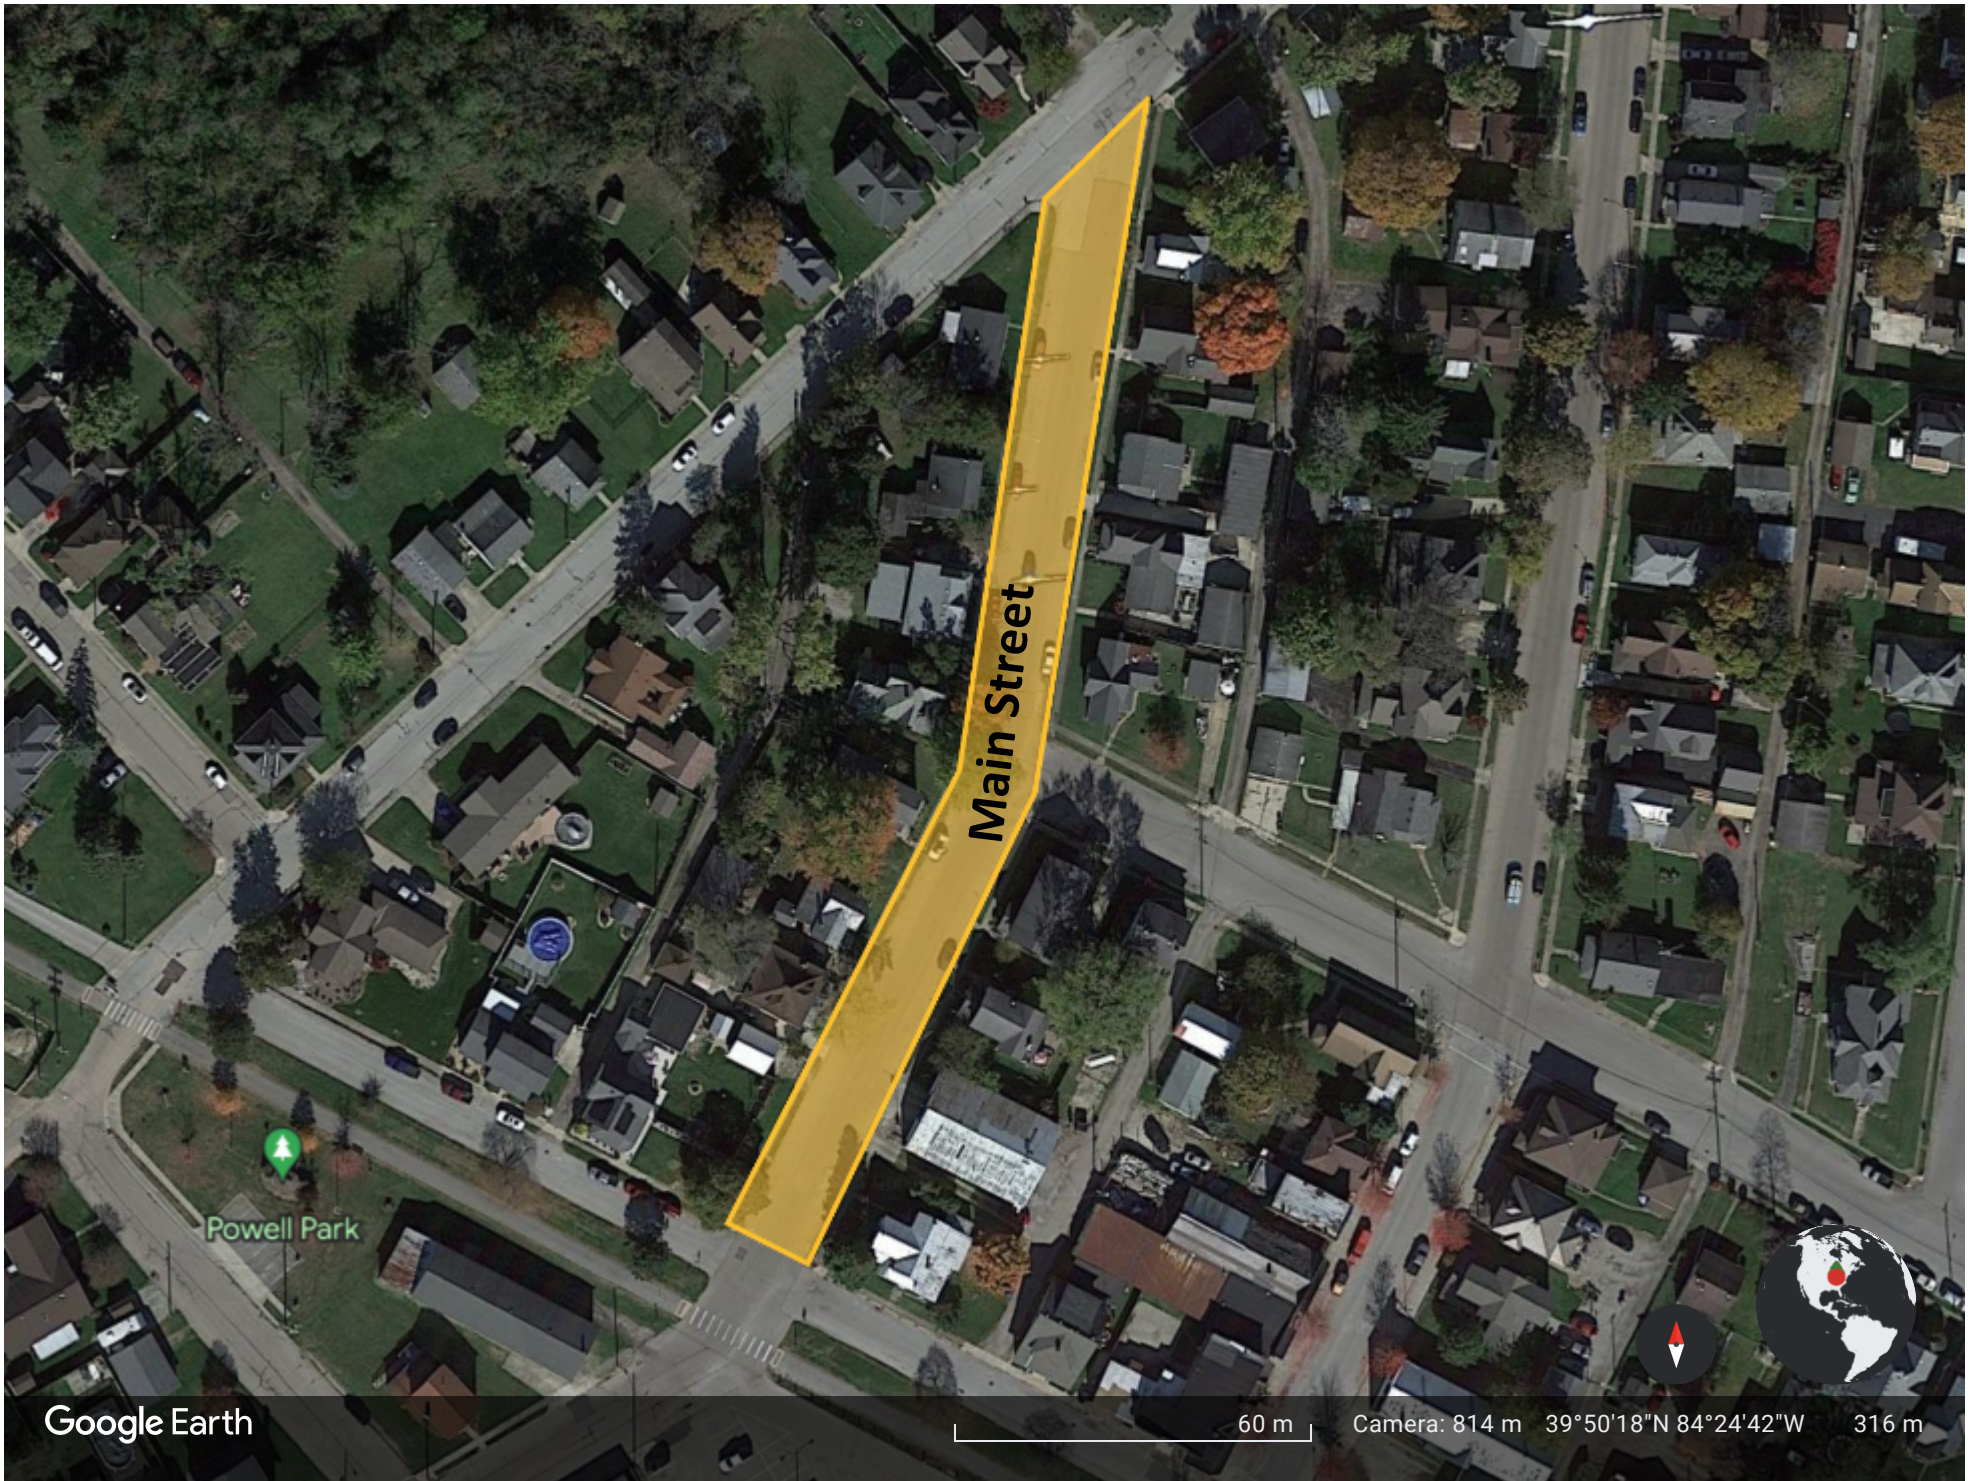

Google Earth

Vicinity Map