

OPWC DISTRICT 4 INTEGRATING COMMITTEE  
FY25 APPLICATION SUMMARY

14

SUBDIVISION: Dayton CONTACT PERSON: Nick Dailey  
PROJECT NAME: Gettysburg-Blueberry-Pennway Water Main Improvement

CRITERIA		RESPONSE			
	Project Type	Water			
	General Project Summary	Existing deteriorated 6" high pressure water mains on Gettysburg Avenue, Blueberry Drive and Pennway Place will be replaced with 8" high pressure water main. The project will include new water main, valves and fire hydrants as well pavement restoration.			
1.	Priority Project?	No			
2.	Total Project Cost	\$890,000			
	Funding Requested SCIP	\$200,000			
	Funding Requested LTIP	n/a			
	New/ Expansion	\$0			
3.	Type of Request	Grant			
4.	Local Match SCIP	\$690,000	78%		
	Local Match LTIP	n/a			
5.	Economic Health	5			
6.	Infrastructure Age	60 years			
7.	Generation of Revenue	None			
8.	Additional Funding	None			
9.	Readiness of Project	Ready to Proceed			
10.	Health & Safety - Category	Water line			
	Response	Average of 8 breaks per 1,000 LF			
11.	Addresses District Needs	System Users	28	Avg. Daily Traffic	
		Acres Drained		Project in Multiple Communities?	
		Percent of Community Served?			Less than 25%
12.	Economic development	none			
	# jobs being created				
	# jobs retained				
13.	Relieves Traffic Congestion Responds to Growth	n/a			LTIP only Criteria
14.	Weighted Useful Life	40 years			
15.	Engineering as % of Construction	0%			
16.	Other Factors				
COMMENTS					

1.0 Project Financial Information (All Costs Rounded to Nearest Dollar)

1.1 Project Estimated Costs

Engineering Services

Preliminary / Final Design: \_\_\_\_\_ .00  
 Construction Administration: \_\_\_\_\_ .00  
 Total Engineering Services: a.) \_\_\_\_\_ .00 \_\_\_\_\_ %  
 Right of Way: b.) \_\_\_\_\_ .00  
 Construction: c.) \_\_\_\_\_ .00  
 Permits, Advertising, Legal: e.) \_\_\_\_\_ .00  
 Construction Contingencies: f.) \_\_\_\_\_ .00  
 Total Estimated Costs: g.) \_\_\_\_\_ .00

1.2 Project Financial Resources

Local Resources

Local In-Kind or Force Account: a.) \_\_\_\_\_ .00  
 Local Revenues: b.) \_\_\_\_\_ .00  
 Other Public Revenues:  
 Local / ODOT - Let: \_\_\_\_\_ d.) \_\_\_\_\_ .00  
 ODOT PID: \_\_\_\_\_  
 OEPA / OWDA: e.) \_\_\_\_\_ .00  
 CDBG: f.) \_\_\_\_\_ .00  
 Other: \_\_\_\_\_ g.) \_\_\_\_\_ .00  
 Subtotal Local Resources: i.) \_\_\_\_\_ .00 \_\_\_\_\_ %

OPWC Funds (Check all requested and enter Amount)

Grant: \_\_\_\_\_ % of OPWC Funds j.) \_\_\_\_\_ .00  
 Loan: \_\_\_\_\_ % of OPWC Funds k.) \_\_\_\_\_ .00 \_\_\_\_\_ yrs  
 Loan Assistance / Credit Enhancement: l.) \_\_\_\_\_ .00  
 Subtotal OPWC Funds: m.) \_\_\_\_\_ .00 \_\_\_\_\_ %  
 Total Financial Resources: n.) \_\_\_\_\_ .00 \_\_\_\_\_ %

# OHIO PUBLIC WORKS COMMISSION

## DISTRICT 4

### FY25 Supplemental Questionnaire

---

**Applicant:** [City of Dayton](#)

---

**Project Title:** [Gettysburg-Blueberry-Pennway Water Main Improvements](#)

---

#### Application Summary:

**Briefly describe the project:**

The existing deteriorated 6 inch, high pressure water mains on Gettysburg Avenue, Blueberry Drive and Pennway Place will be replaced with 8 inch, high pressure water main. The project will include new water main, valves and fire hydrants upgraded to current Water Engineering Standards. Pavement restoration will be included.

# Gettysburg-Blueberry-Pennway Water Main Improvement Location - Project Limits

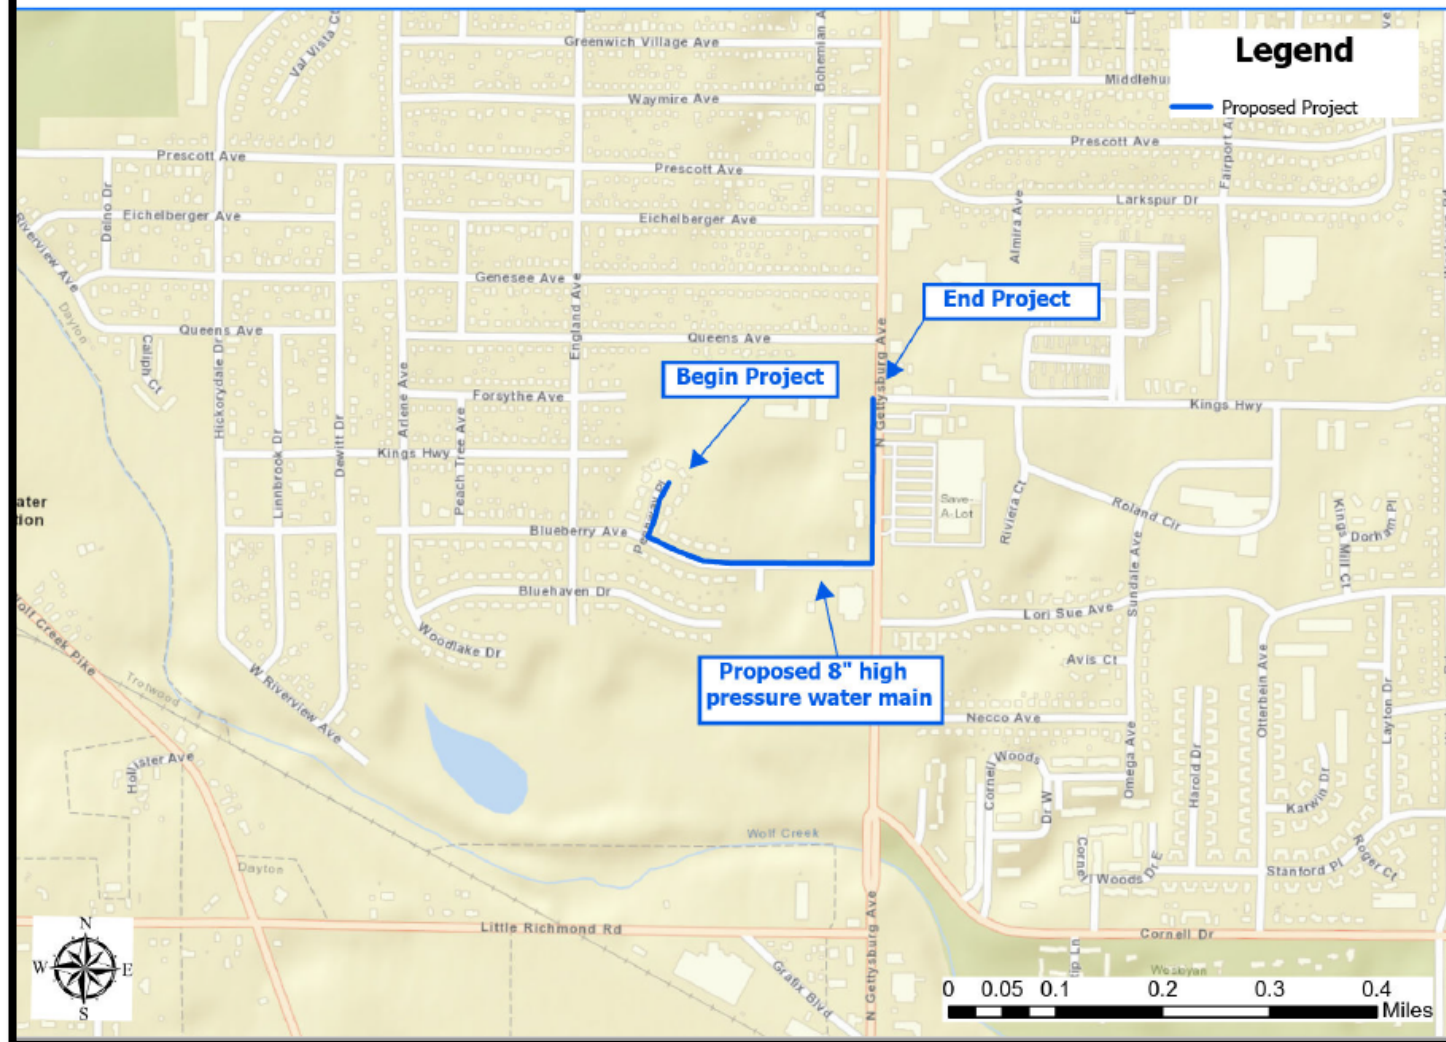


Figure 2-Gettysburg-Blueberry-Pennway Water Main Improvements Project Limits